



Transmission Water Main Repair
















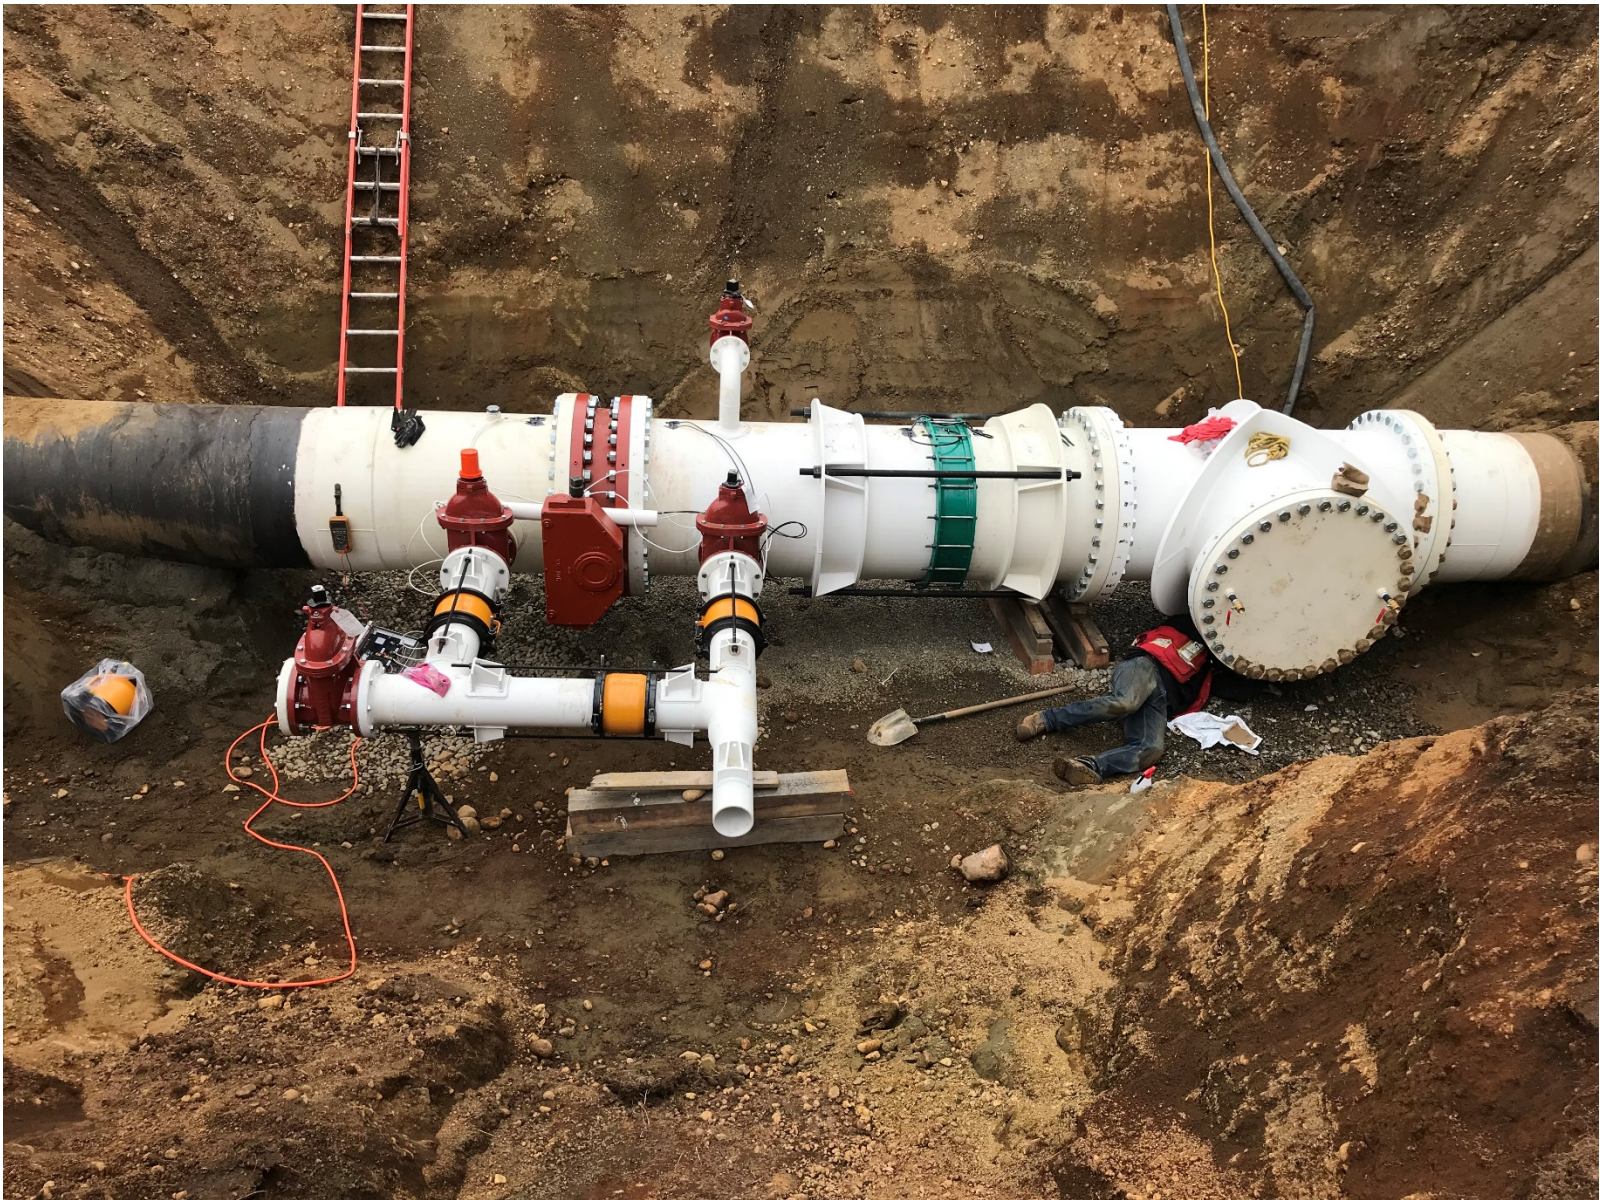

Next Steps

- Contractor and consultant debrief
- Installation and optimization of corrosion protection system
- Formalize maintenance/monitoring program
- Report back to Committee

Effectiveness and Next Steps

STAGE 4


UV FACILITY TOTALS - GRAPH

OVERVIEW

TOTALS

FLOW TOTALS (m3)


Flow Total (m3)

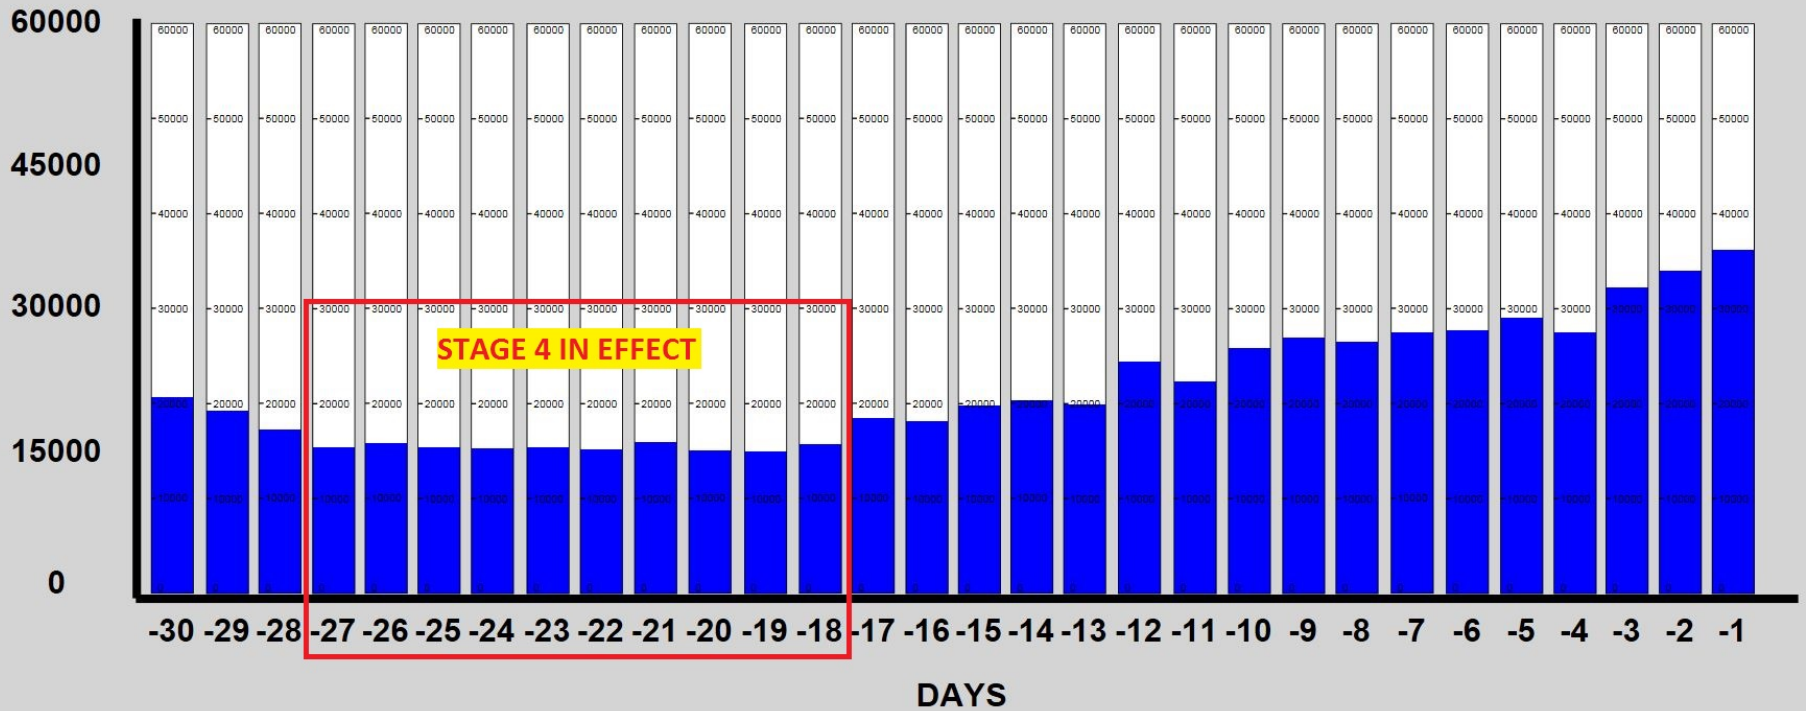

- WS Overview
- Black Creek
- Comox
- Court Station
- Crown Isle
- Dingwall
- East Court
- Marsden
- Oyster River
- Royston
- Ryan Road
- UV Facility
- West Court

FLOW TOTALS (m3)

Flow Total (m3)

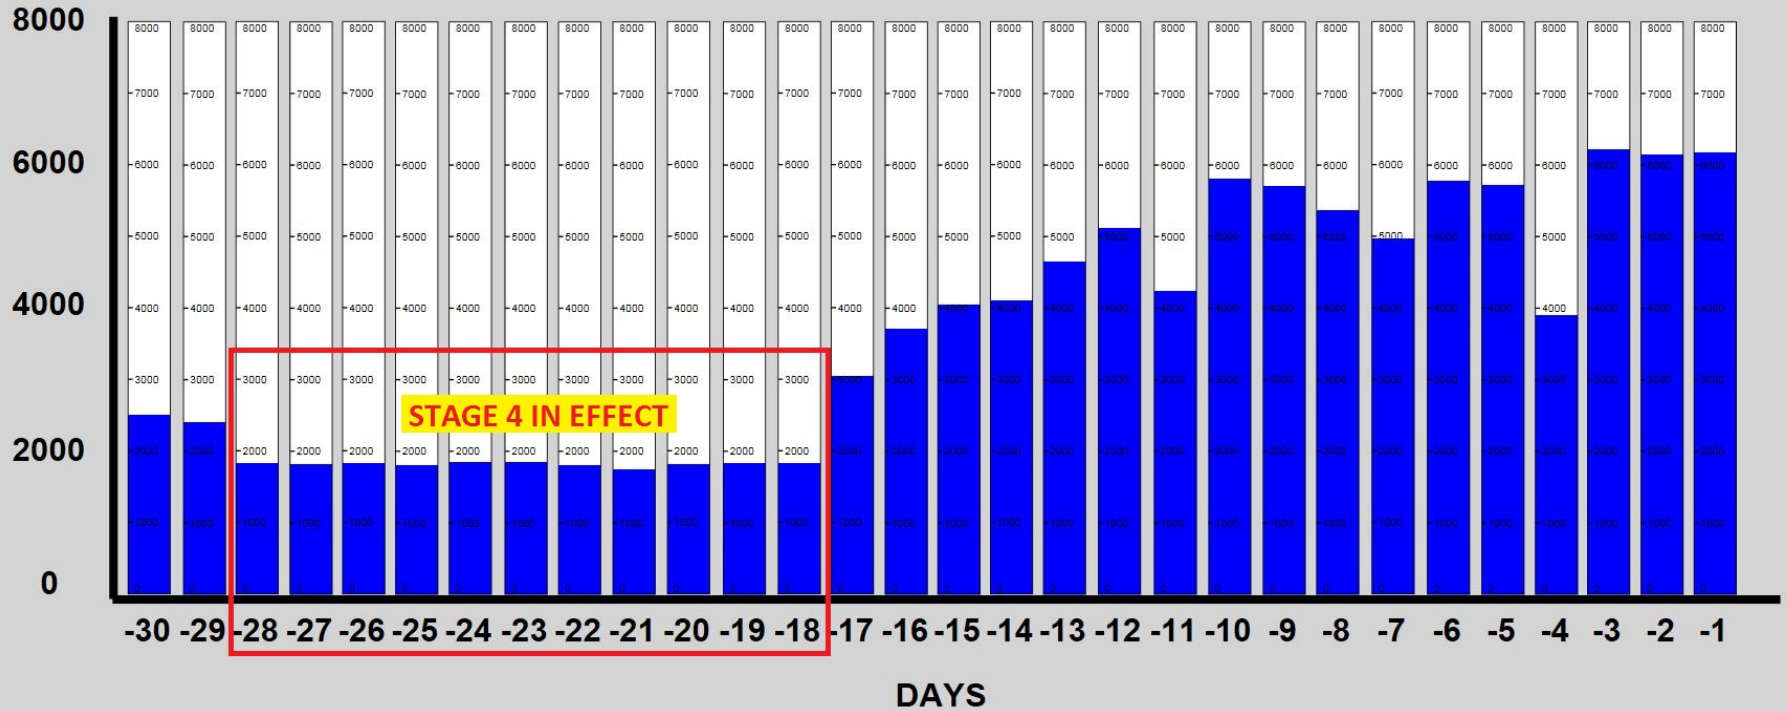

- WS Overview
- Black Creek
- Comox
- Court Station
- Crown Isle
- Dingwall
- East Court
- Marsden
- Oyster River
- Royston
- Ryan Road
- UV Facility
- West Court

Next Steps

- Debrief (led by emergency services) with engineering, corporate services, bylaw, municipal staff
- Review of internal procedures
- Review of bylaw
- Report back to Committee along with proposed bylaw amendments